


1.Wiring Diagram.

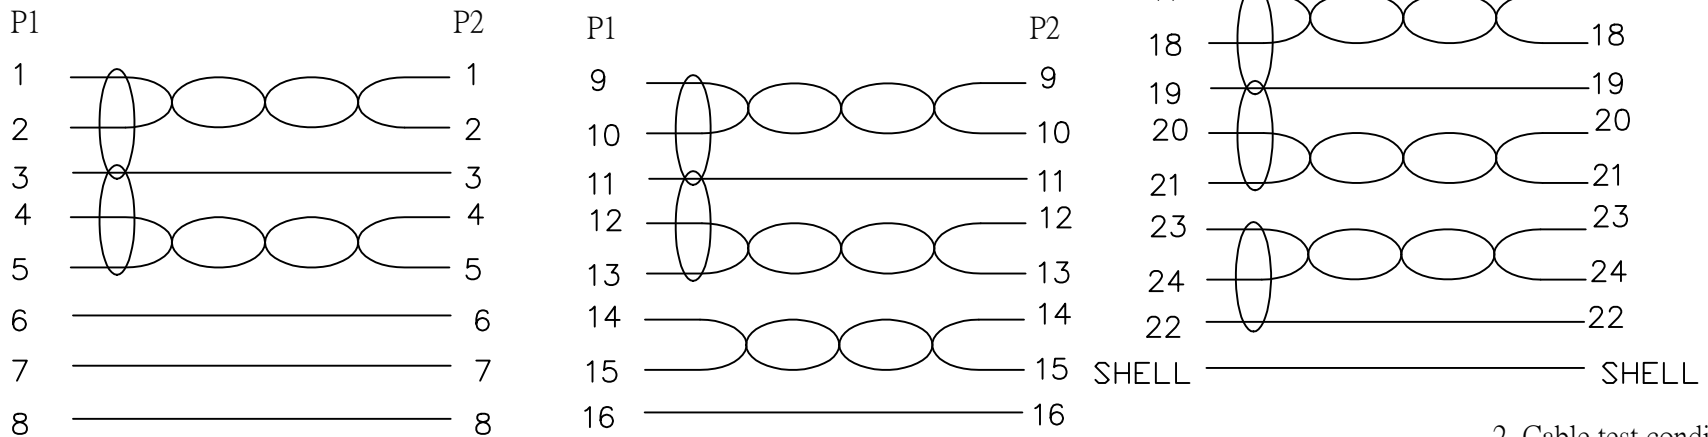

2. Cable test condition:
 Open/Short :100%
 Insulation resistance:5M ohm
 Contact resistance:2 ohm
 Hipot: DC 300V/1 sec
 3.Each pcs with PE polybage

10	TUBE	HEAT SHRINK TUBE OD2.0mm L:8mm	14	
9	TUBE	HEAT SHRINK TUBE OD1.5mm L:15mm	8	
8	TUBE	HEAT SHRINK TUBE OD1.0mm L:25mm	2	
7	COPPER	COPPER FOIL W30mm*L75mm	2	
6	SCREW	#4-40UNC RE34 WHITE	4	
5	PE	LLDPE 500026 6201	20g	
4	PVC	45P PVC WHITE OVERMOLD	50g	
3	FERRITE	OD17.5*L28.5*ID9.5	2	
2	CONN	DVI24+1 MALE G/F INSULATION BLACKSHELL NICKEL PIN G/F	2	P1.P2
1	CABLE	UL20276 {28AWG (7/0.12TC) *1P+D28AWG(7/0.12TC)+AL/MY}*7 +28AWG(7/0.12TC)*1P+28AWG (7/0.12TC) *3C+A+B (96/0.12AM) OD8.6 BLACK	1	5000mm
NO.	PART NO.	DESCRIPTION	QTY	UNIT/REF
BILL OF MATERIAL				

A		2014/08/24		
CnC Tech,LLC		P/N:	750-10011-00500	REV A
		TITLE	CBL DVI24+1 MALE TO DVI 24+1 MALE	
DRAWN	WENC	DATE	08/24/14	CUSTOMER P/N:
CHECKED	EDWIN	DATE	08/24/14	CUSTOMER:
APPROVAL				
		SHEET 1 OF 1		