22/10/2012 www.crouzet.com




EWS / EWS2 phase sequence and loss of phase EWS Part number 84892299



- Space savings, accurate measurement and optimized functions all improve the efficiency of your electrical installation.
- Control: You simply install your EWS phase control relay and without any adjustment you can monitor the loss or inversion of one of the phases.
- Safety: The EWs range enables you to choose the level of safety for your installation by using versions with 1, 2 or 3 output changeovers.
- Self-powered : Simple to install, EWS control relays use the controlled mains supply for their own power supply voltage.

Part numbers		
Туре	Output relay	
84 892 299 EWS	1 changeover	
84 873 004 EWS2	2 changeovers	

Specifications 3 AC 230...440 V 50 / 60 Hz +/- 1 Hz Maximum consumption 25 VA No cadmium Type of contacts Nominal rating 8 A Maximum breaking voltage 250 V AC Max. voltage 440 V AC Nominal breaking capacity 2000 VA $10 \, \text{mA} \, / \, 5 \, \text{V}$ Electrical life (number of operations AC 12: 10⁵ at 8A/250 VAC Maximum rate (at full load) 360 operations / hour Mechanical life (operations) 2×10^{7} Pick-up delay T1 200 ms Turn-off delay T2 300 ms in the event of phase failure Connection capacity - without ferrule 2 x 2,5 mm² 1 x 4 mm² Connection capacity - with ferrule 2 x 1,5 mm² 1 Nm (screw M3 / IEC 947-1 Max. tightening torque Operating temperature range (°C) -30 →+70 Storage temperature (⁰C) Self-extinguishing Protection (IEC 60529) - Casing IP40 Protection (IEC 60529) - Term. block IP20 Dielectric strength (IEC 60255-5) 2,5 KV / 1 mn / 1 mA / 50 Hz Insulation coordination (IEC/EN 60664-1) Overvoltage category III, degree of pollution 3 Weight (g) 110

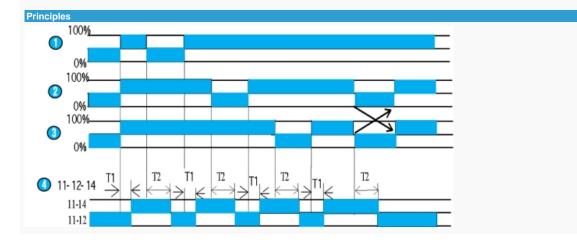

22/10/2012 www.crouzet.com

Operating principle

EWS/EWS2 relays monitor the correct sequencing of phases L1, L2 and L3 as well as the loss of one of these phases.

When the phase sequence is correct, the output relay is energised, indicated by a yellow LED.


The relay de-energises (LED off) if one of the following faults occurs: Incorrect sequence of phases at terminals L1, L2 and L3

Total loss of one phase or all three phases (loss of phase detection threshold < 50 VAC)

Nº	Legend
•	Phase L1
O	Phase L2
•	Phase L3
•	Relay


Dimensions (mm)

EWS / EWS2

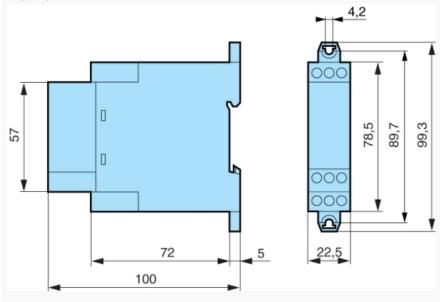

Connections


EWS

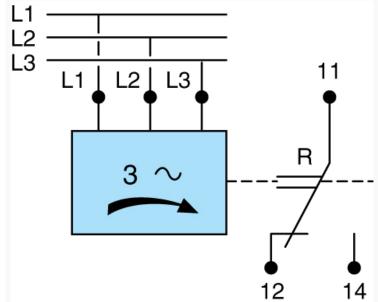

Connections

EWS


22/10/2012 www.crouzet.com

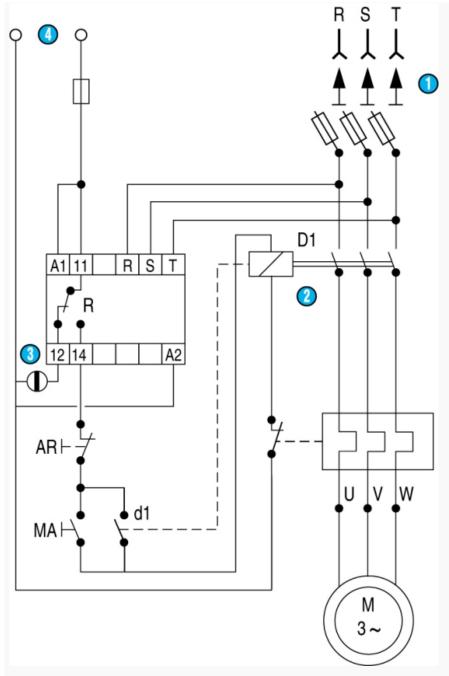

Nº	Legend
0	Isolating switch
②	Contactor
3	Alarm
4	Auxiliary power supply for contactor coil and signalling

EWS : Monitoring of three-phase motor. Manual re-engage after disappearance of the fault.

22/10/2012 www.crouzet.com

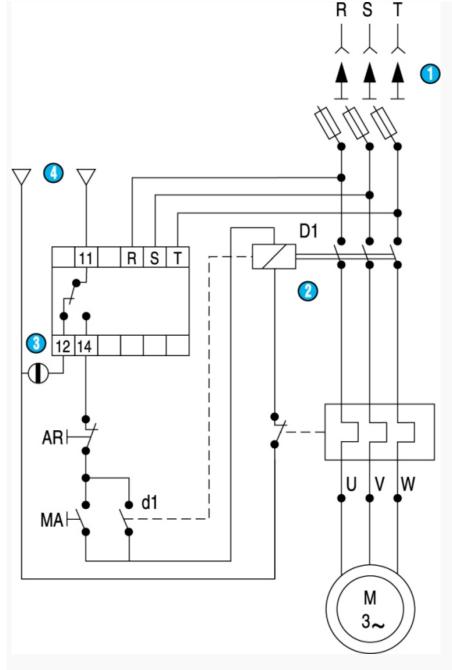

Surveillance moteur triphasé Réenclenchement manuel après disparition du défaut. defecto

Nº	Legend
0	Isolating switch
②	Contactor
0	Alarm
4	Auxiliary power supply for contactor coil and signalling