


## HER Red / Green GMA26481C (BI-COLOR)

## PACKAGE DIMENSIONS

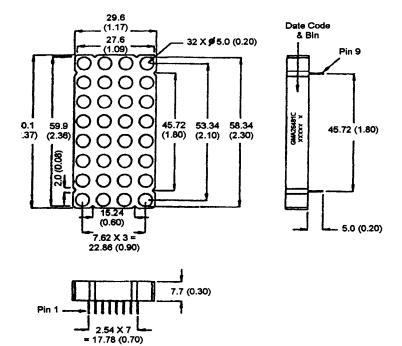

### DESCRIPTION

The GMA26481C a common cathode column 4 X 8, bicolor High Efficiency Red / green dot matrix display. It has a black face with neutral segment color.

### **FEATURES**

2.3" (58.4mm) character height.
Low power requirement.
Wide 130 viewing angle.
High brightness and contrast
4 X 8 array with X-Y select.
X-Y stackable.
Easy mounting on P.C. board.

#### NOTE: Dimensions are in mm (inch). Tolerances are $\pm$ 0.25 (0.1) unless otherwise noted. All pins are 0.5 (.02).

## **MODEL NUMBER**

Part NumberColourDescriptionGMA26481CHER Red/GreenCommon anode row.(For other color options, contact your local area Sales Office)



## **ABSOLUTE MAXIMUM RATING** (T<sub>A</sub> = 25°C unless otherwise specified)

		•		
	HER	Green	Units	
Peak forward current per segment	90	90	mA	
(Duty cycle 1/10, 10KHz)				
Continous IF per segment	25	25	mA	
Power dissipation per segment	70*	70	mW	
*Derate linearly from 25°C	0.33	0.33	mW/°C	
Reverse voltage VR per segment	5	5	Volts	
Operating and storage temperature range			25°C to +85°C	
Soldering time at 260°C	-			
(1/16" below seating plane)				

**ELECTRO - OPTICAL CHARACTERISTICS** (T<sub>A</sub> = 25°C unless otherwise specified)

		Test
HER	Green	<b>Condition</b>
2200ucd	1600ucd	l <sub>F</sub> = 20mA
2.0V	<b>2.1V</b>	l <sub>F</sub> = 20 mA
2.8V	<b>2.8V</b>	l <sub>F</sub> = 20 mA
635nm	570nm	l <sub>F</sub> = 20 mA
45nm	30nm	l <sub>F</sub> = 20mA
5V	5V	l <sub>R</sub> = 100uA
	2200ucd 2.0V 2.8V 635nm 45nm	2200ucd       1600ucd         2.0V       2.1V         2.8V       2.8V         635nm       570nm         45nm       30nm




## **PIN CONNECTION:**

## GMA3688C

		<b>_</b>			
Pin Number	Function	Pin Number	Function		
1	Cathode Column 1a	9	Anode Row 1		
2	Cathode Column 1b	10	Anode Row 2		
3	Cathode Column 2a	11	Anode Row 3		
4	Cathode Column 2b	12	Anode Row 4		
5	Cathode Column 3a	13	Anode Row 5		
6	Cathode Column 3b	14	Anode Row 6		
7	Cathode Column 4a	15	Anode Row 7		
8	Cathode Column 4b	16	Anode Row 8		
		1			
Note "a" = High Efficiency Red LED					


"b" = Green LED

### SCHEMATIC:






#### **GRAPHICAL DETAIL: High Efficiency Red** (T<sub>A</sub> = 25°C unless otherwise specified)

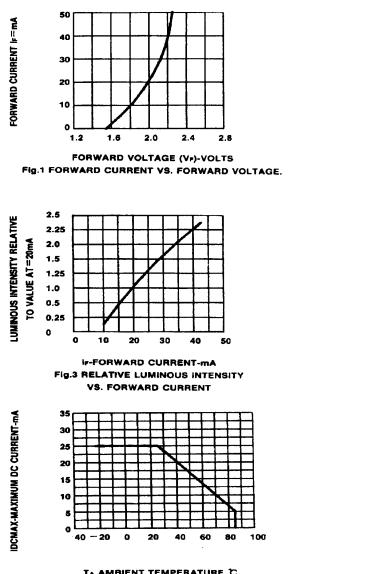




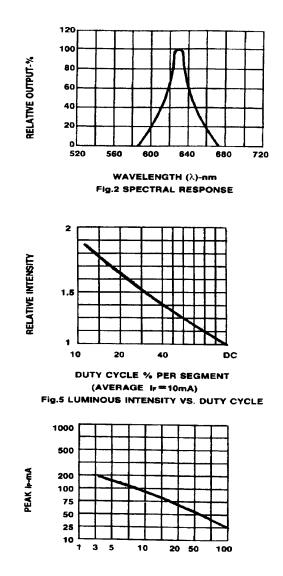



DUTY CYCLE % Fig. 5 MAX PEAK CURRENT VS. DUTY CYCLE % (REFRESH RATE (=1 KHz)




#### **GRAPHICAL DETAIL: Green** (T<sub>A</sub> = 25°C unless otherwise specified)











IDCMAX-MAXIMUM DC CURRENT-mA

TA AMBIENT TEMPERATURE C Fig.4 MAXIMUM ALLOWABLE DC CURRENT PER SEGMENT CS. A FUNCTION OF AMBIENT TEMPERATURE

100




WAVELENGTH ( $\lambda$ )-nm Fig.2 SPECTRAL RESPONSE



**RELATIVE INTENSITY** 

DUTY CYCLE % PER SEGMENT (AVERAGE I==10mA) Fig.5 LUMINOUS INTENSITY VS. DUTY CYCLE



DUTY CYCLE % Fig. 6 MAX PEAK CURRENT VS. DUTY CYCLE % (REFRESH RATE 1=1 KHz)



#### DISCLAIMER

FAIRCHILD SEMICONDUCTOR RESERVES THE RIGHT TO MAKE CHANGES WITHOUT FURTHER NOTICE TO ANY PRODUCTS HEREIN TO IMPROVE RELIABILITY, FUNCTION OR DESIGN. FAIRCHILD DOES NOT ASSUME ANY LIABILITY ARISING OUT OF THE APPLICATION OR USE OF ANY PRODUCT OR CIRCUIT DESCRIBED HEREIN; NEITHER DOES IT CONVEY ANY LICENSE UNDER ITS PATENT RIGHTS, NOR THE RIGHTS OF OTHERS.

#### LIFE SUPPORT POLICY

FAIRCHILD'S PRODUCTS ARE NOT AUTHORIZED FOR USE AS CRITICAL COMPONENTS IN LIFE SUPPORT DEVICES OR SYSTEMS WITHOUT THE EXPRESS WRITTEN APPROVAL OF THE PRESIDENT OF FAIRCHILD SEMICONDUCTOR CORPORATION. As used herein:

- Life support devices or systems are devices or systems which, (a) are intended for surgical implant into the body, or (b) support or sustain life, and (c) whose failure to perform when properly used in accordance with instructions for use provided in the labeling, can be reasonably expected to result in a significant injury of the user.
- 2. A critical component in any component of a life support device or system whose failure to perform can be reasonably expected to cause the failure of the life support device or system, or to affect its safety or effectiveness.